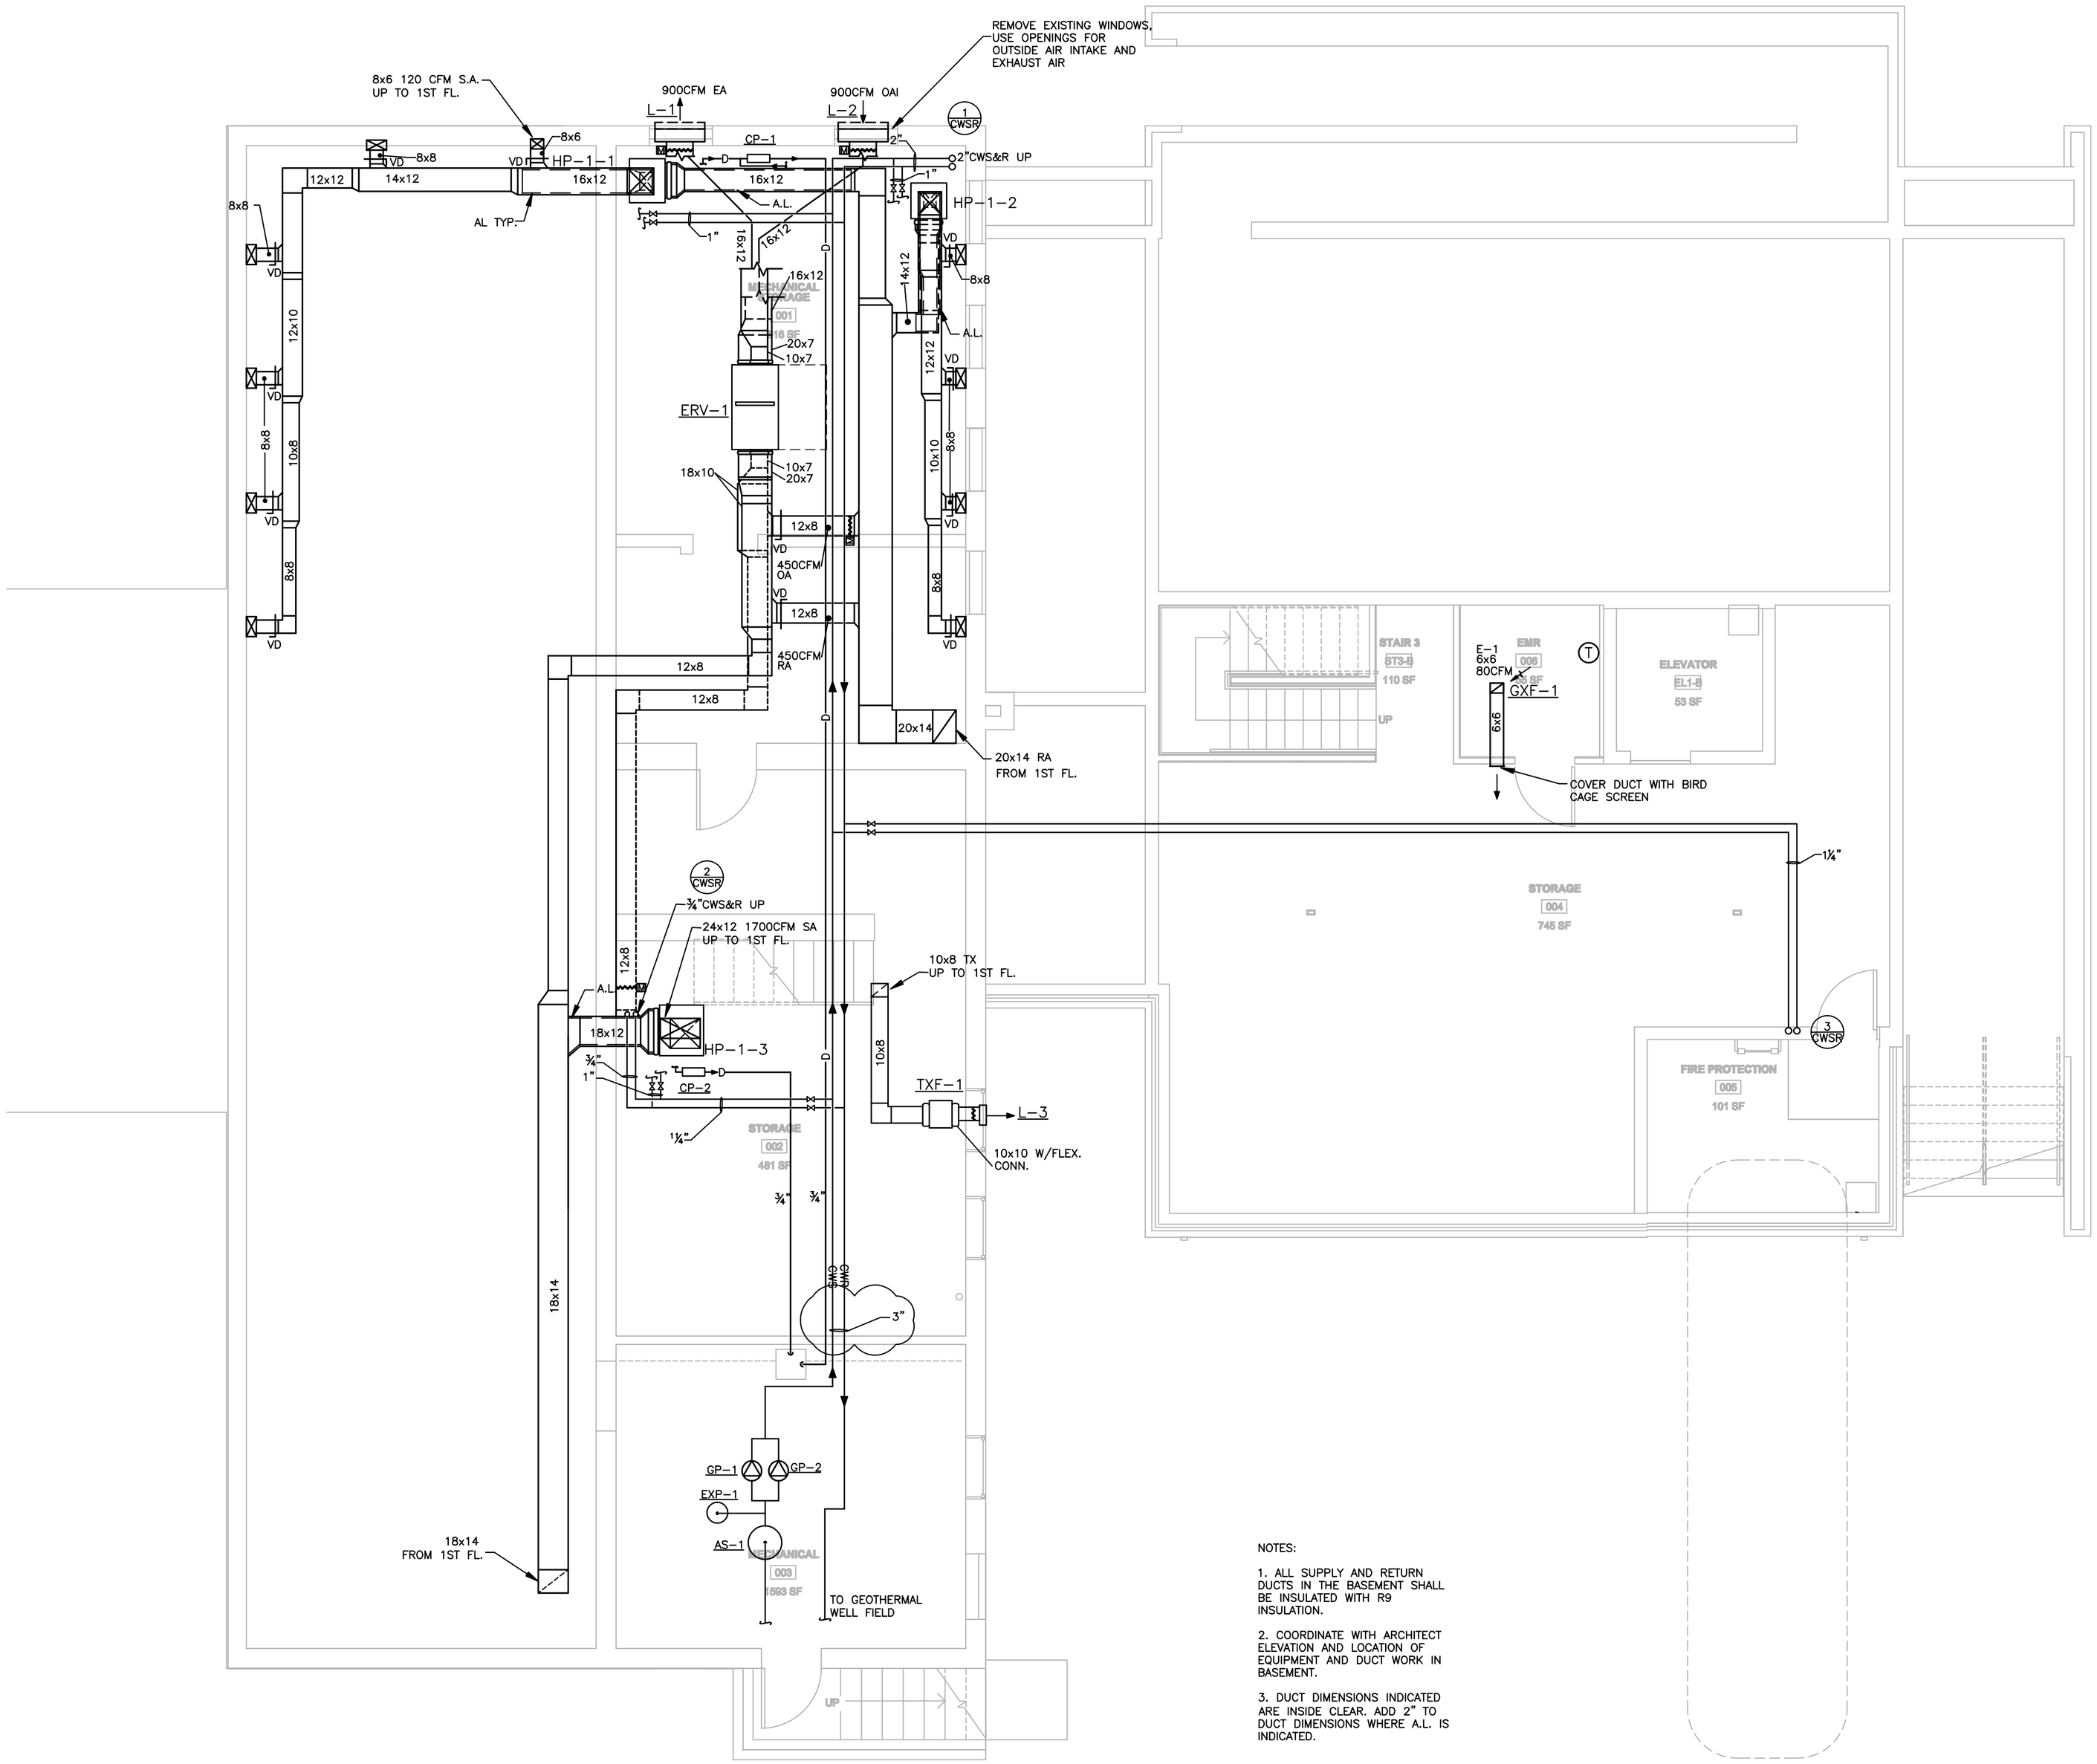

NOTES:

1. ALL SUPPLY AND RETURN DUCTS IN THE BASEMENT SHALL BE INSULATED WITH R9 INSULATION.

2. COORDINATE WITH ARCHITECT ELEVATION AND LOCATION OF EQUIPMENT AND DUCT WORK IN BASEMENT.

3. DUCT DIMENSIONS INDICATED ARE INSIDE CLEAR. ADD 2" TO DUCT DIMENSIONS WHERE A.L. IS INDICATED.

ARCHITECT

bh+a

Bergmann Hendrie + Archetype, Inc.
300 A Street
Boston, MA 02210
617 350-0450 Tel
617 350-0215 Fax
www.bhplus.com

PROJECT NAME

Bluemont Community Center

33846 Snickersville Turnpike
Bluemont, VA

CLIENT

Loudoun County, Virginia Department of Construction and Waste management

211 Gibson Street NW
Leesburg, VA 20176
(703) 737-8998 tel
(703) 771-5097 fax

PROJECT TEAM

Civil/ Landscape:
William H. Gordon Associates, Inc.
44064 Riverside Pkwy, Suite 100
Leesburg, VA 20176
703-729-9009 tel

Structural:
Linton Engineering, Inc.
8229 Boone Boulevard
Vienna, VA 22182
571-323-0320 tel

Plumbing/ Fire Protection/ Mechanical/ Electrical:
Landmark Facilities Group
252 East Avenue
Norwalk, CT 06855
203-866-4626 tel

REVISIONS

1	Addendum # 2	09/21/10
2		
3		
4		
5		

DATE

DRAWING TITLE

Basement Plan

DRAWING INFORMATION

August 20, 2010
DATE OF ISSUE
Bid Documents
DESCRIPTION

SCALE: 1/4" = 1'-0"
DRAWN BY: AH
PROJECT #
FILE NAME

DRAWING NUMBER

M-100

Copyright BH+A, Inc.