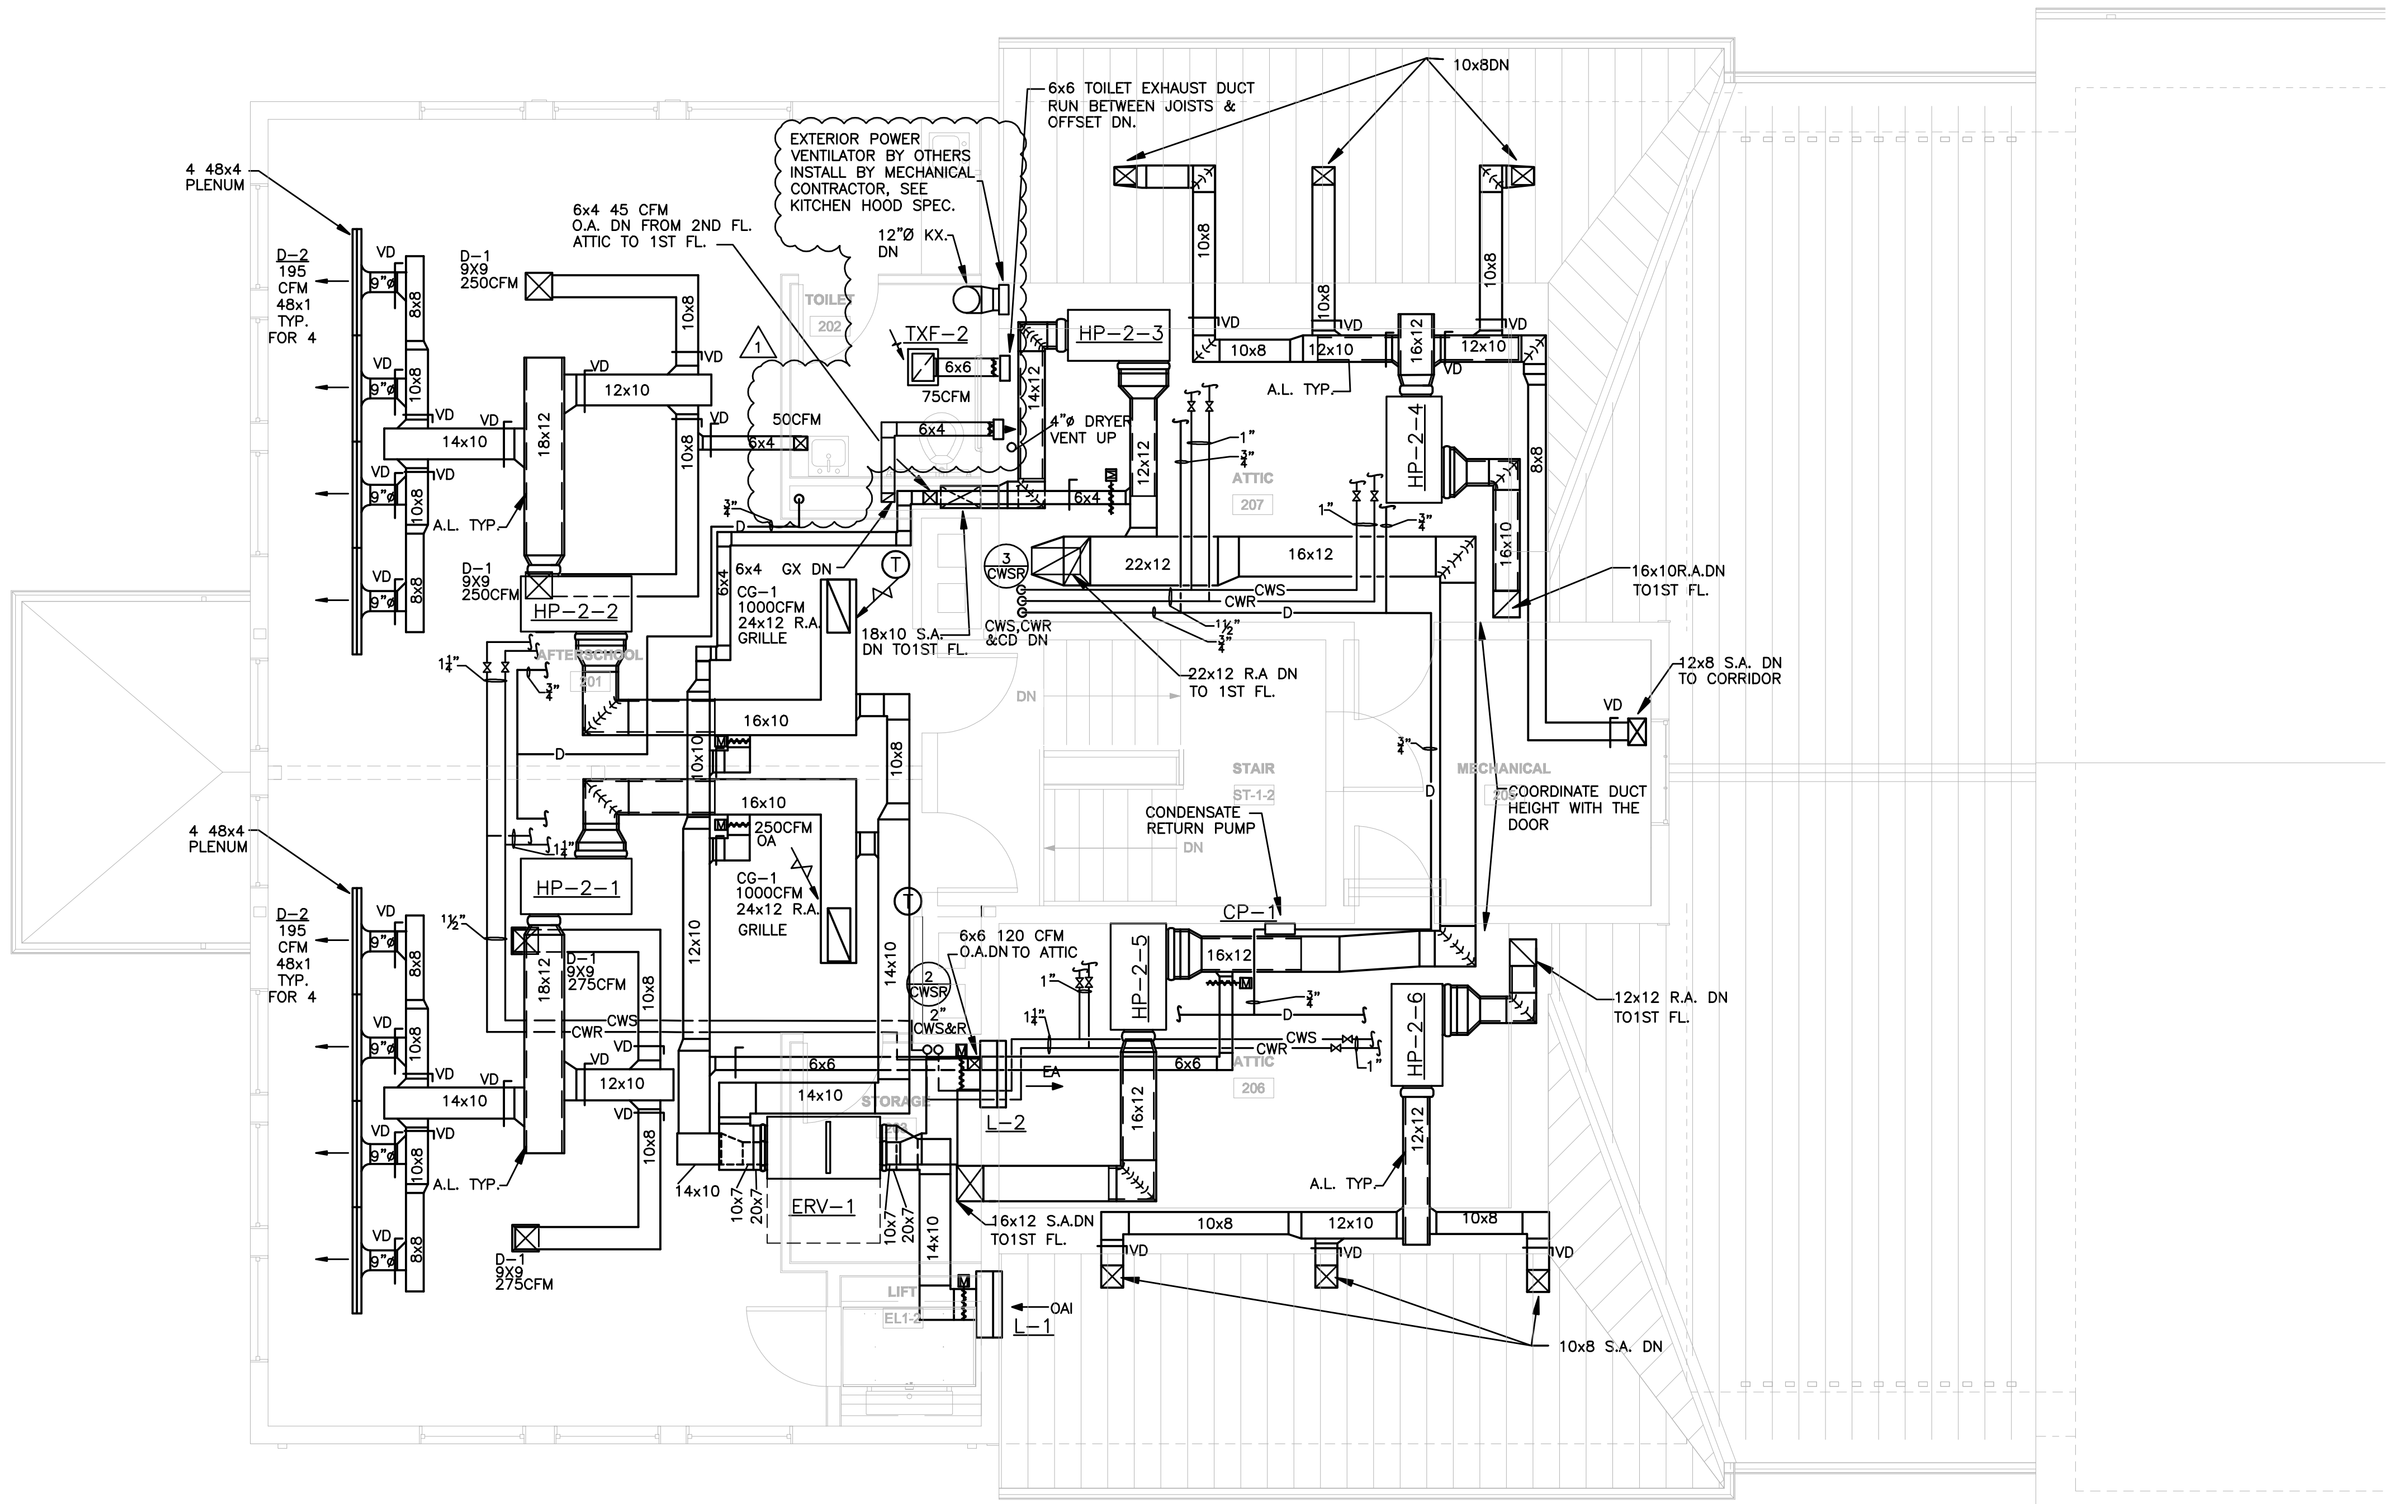


NOTE:
ALL SUPPLY AND RETURN DUCTS IN THE ATTIC SHALL BE INSULATED WITH R9 INSULATION. LAY OUT ON CEILING AND COVER WITH R-30 ISULATION

**ARCHITECT**

bh+a

Bergmann Hendrie + Archetype, In
300 A Street
Boston, MA 02210
617 350-0450 Tel
617 350-0215 Fax
www.bhplus.com

**PROJECT NAME**

# Lucketts Community Center

42361 Lucketts Road
Lucketts, Virginia

**CLIENT**

Loudoun County Virginia 1757

## Loudoun County, Virginia Department of Construction and Waste Management

211 Gibson St NW
Lucketts, VA 20176
(703) 737-8998 tel
(703) 771-5097 fax

**PROJECT TEAM**

**Civil / Landscape:**
William H. Gordon Associates, Inc
44084 Riverside Pkwy, Suite 100
Leesburg, VA 20176
703-729-9009 tel
703-478-8517 fax

**Structural:**
Linton Engineering, Inc.
8229 Boone Boulevard
Vienna, VA 22182
571-323-0320 tel
571 323-0589 fax

**Plumbing/ Fire Protection/ Mechanical/ Electrical**
Landmark Facilities Group
252 East Avenue
Norwalk, CT 06855
203-866-4626 tel
203-866-8019 fax

**REVISIONS**

| | | |
|---|---|---|
| 1 | Addendum #1 | 8-4-10 |
| 2 | | |
| 3 | | |
| 4 | | |
| 5 | | |

DATE

**DRAWING TITLE**

## Second Floor Plan

**DRAWING INFORMATION**

July 16, 2010
DATE OF ISSUE

BID DOCUMENTS
DESCRIPTION

SCALE 1/4" = 1'-0"
DRAWN BY AH
PROJECT #
FILE NAME

**DRAWING NUMBER**

# M102

Copyright BH+A, Inc.