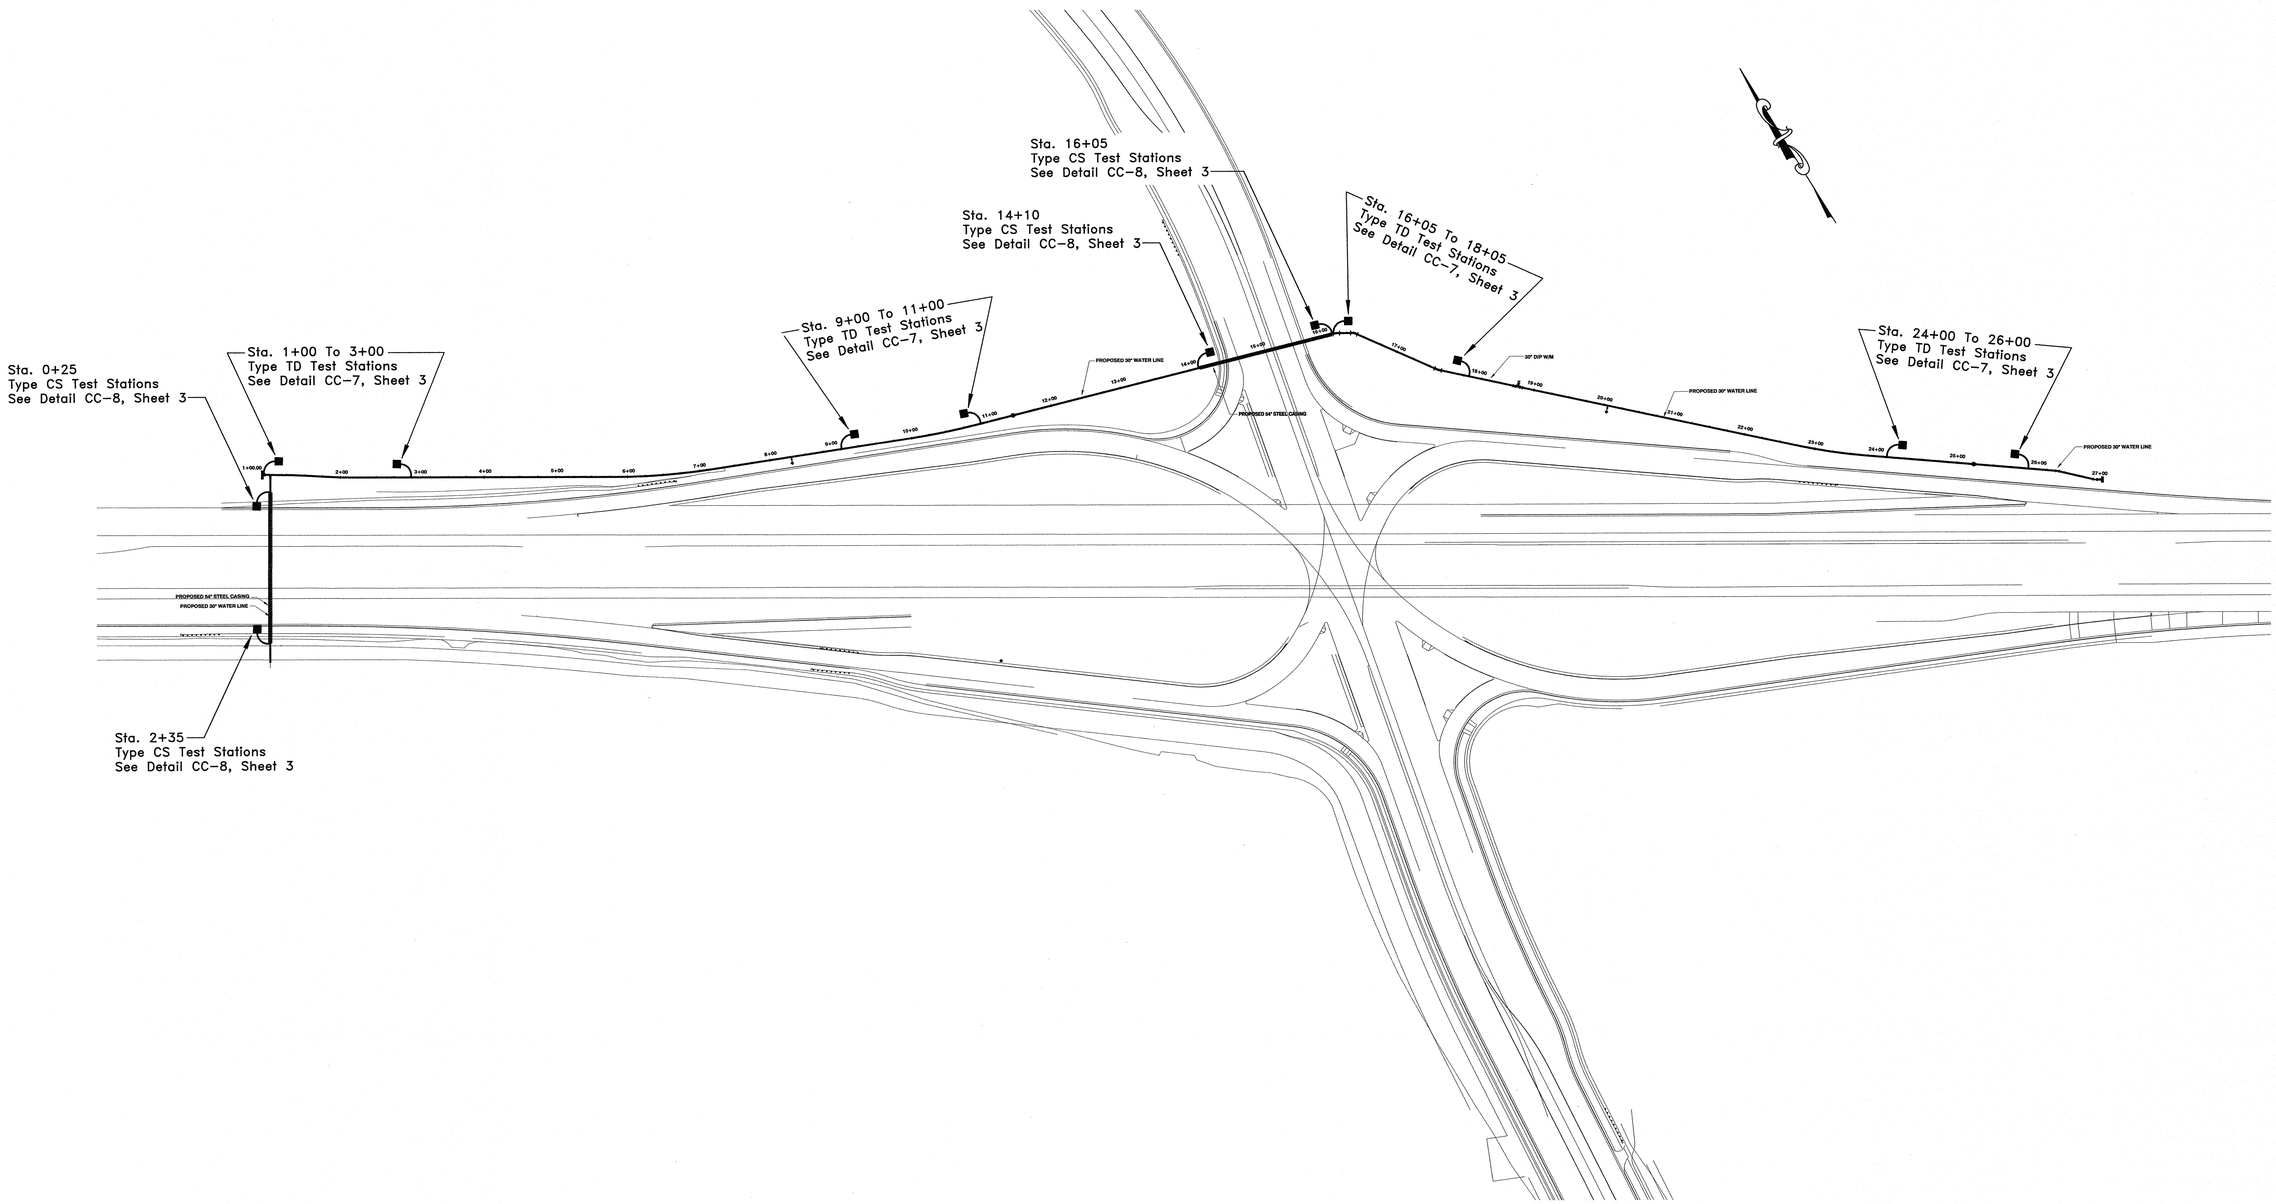

NOTE:
ALL PIPE IS TO BE INSTALLED WITH POLYETHYLENE ENCASEMENT
ALL PIPE SHALL BE BONDED.

LEGEND	
■	CP TEST STATION
▬	PROPOSED 30" D.I.P. WATER MAIN

NACE INTERNATIONAL
WILLIAM M. RIVERS
NO. 2826
5-29-08
CORROSION SPECIALIST

NO.	DATE	BY	REVISION

LCSALogo.tif

LOUDOUN COUNTY SANITATION AUTHORITY
880 HARRISON STREET, SE
LEESBURG, VIRGINIA 20175
(703) 771-1095

CORROSION CONTROL OVERVIEW

SCALE: 1" = 100'

PREPARED BY:
SPS
SYSTEM PROTECTION SERVICES, INC.

SCALE
HORIZ: AS SHOWN
VERT: AS SHOWN
DATE: MAY 2008
DRAWN BY: RJR
CHECKED BY: WMR
APPROVED BY:

PROJECT NO.
JOB NO.
CADD FILE

LOUDOUN COUNTY SANITATION AUTHORITY
RT. 607 AND RT.7 30" WATER MAIN
LOUDOUN COUNTY, V.A.

18(7)

DRAWING 1 OF 5 SHEETS